

LED LINEAR LIGHTING SYSTEM T-LINE INDEPENDENT INSTALLATION




RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY IN ACCORDANCE WITH NATIONAL, LOCAL BUILDING AND ELECTRICAL CODES. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

Safety Notes:

Installation must be performed only by a qualified electrician.

Make sure that the fixture is disconnected from the AC supply.

Track rail
3-wires/1-phases



- Ground Conductor
- Neutral Conductor
- Live Conductor


Recommend track rail brands

Pay attention to the positioning knob. No Reverse Mount!
Improper installation may cause irreparable damage.



Halo:
LZR102, LZR104, LZR106, LZR108
or other 3-wires tracks.

Rails are Provided by Others

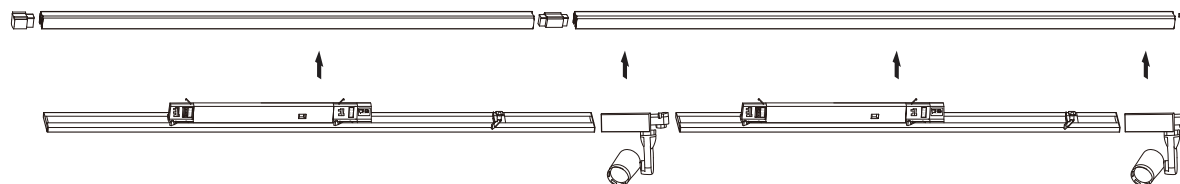


Features:

Perfect solution for the retail business, shops, and supermarkets.
Excellent quality with high efficiency up to 160lm/W.

Four selectable powers with DIP switch.



Flexible position of the luminaire in the rail by sliding left or right.

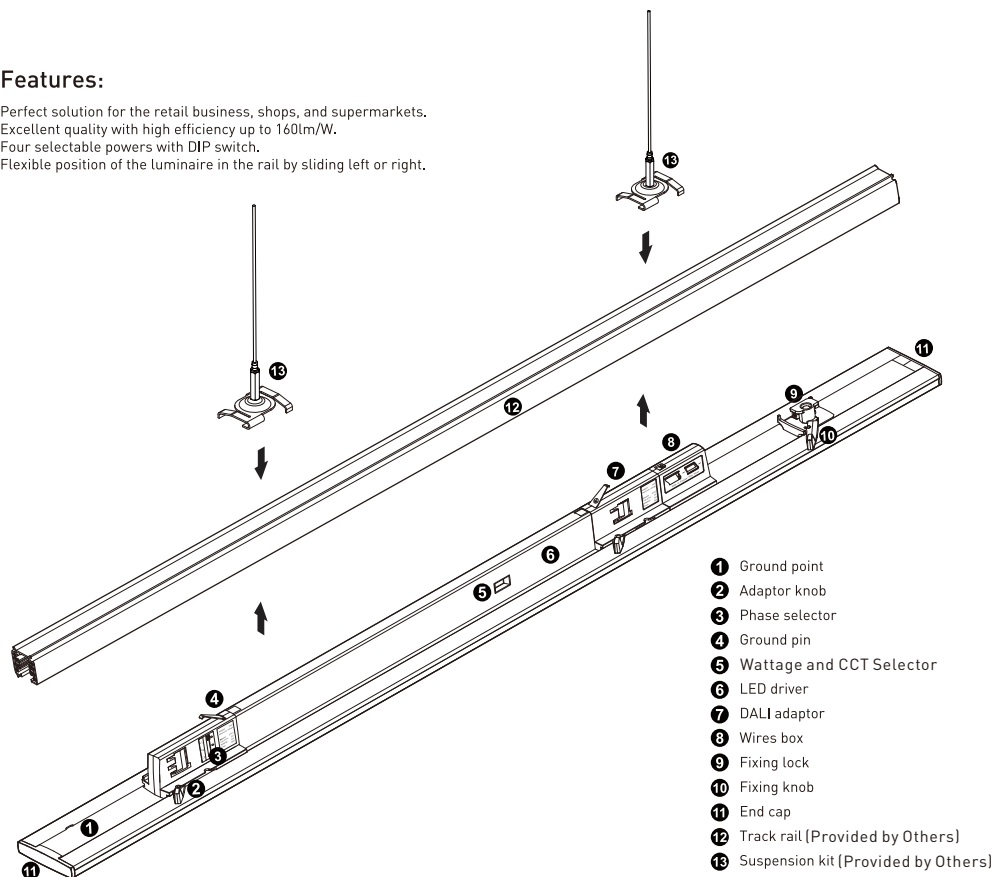

Step 1


Adjust power and CCT as shown before mounting.

Set the power in the **5 wattage and CCT selector** DIP switch.

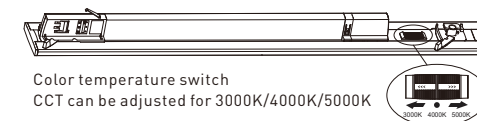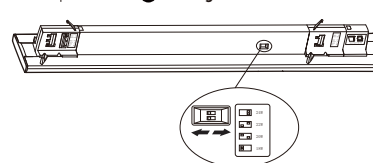


Step 2

Insert the T-line luminaire into the **12 track rail** with the correct direction.

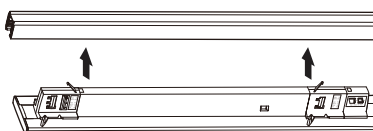

Step 3

Lock the luminaire with the **2 adaptor knob** and the **10 fixing knob** by rotating the knobs clockwise.

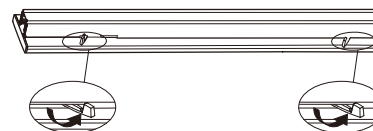

ATTENTION: Install in accordance with national and local building and electrical codes.

All rights reserved. Due to continuous product improvements, specifications and dimensions are subject to change without notice.


LED LINEAR LIGHTING SYSTEM T-LINE INDEPENDENT INSTALLATION



RISK OF FIRE AND ELECTRICAL SHOCK. FIXTURE MUST BE INSTALLED BY A QUALIFIED ELECTRICIAN ONLY IN ACCORDANCE WITH NATIONAL, LOCAL BUILDING AND ELECTRICAL CODES. DISCONNECT POWER AT ELECTRICAL PANEL BEFORE SERVICING.

How to avoid the track rail joints during installation

There are 4 movable positions for the LED driver in the T-line luminaire.
There are 2 movable position of the fixing lock in the T-line luminaire.

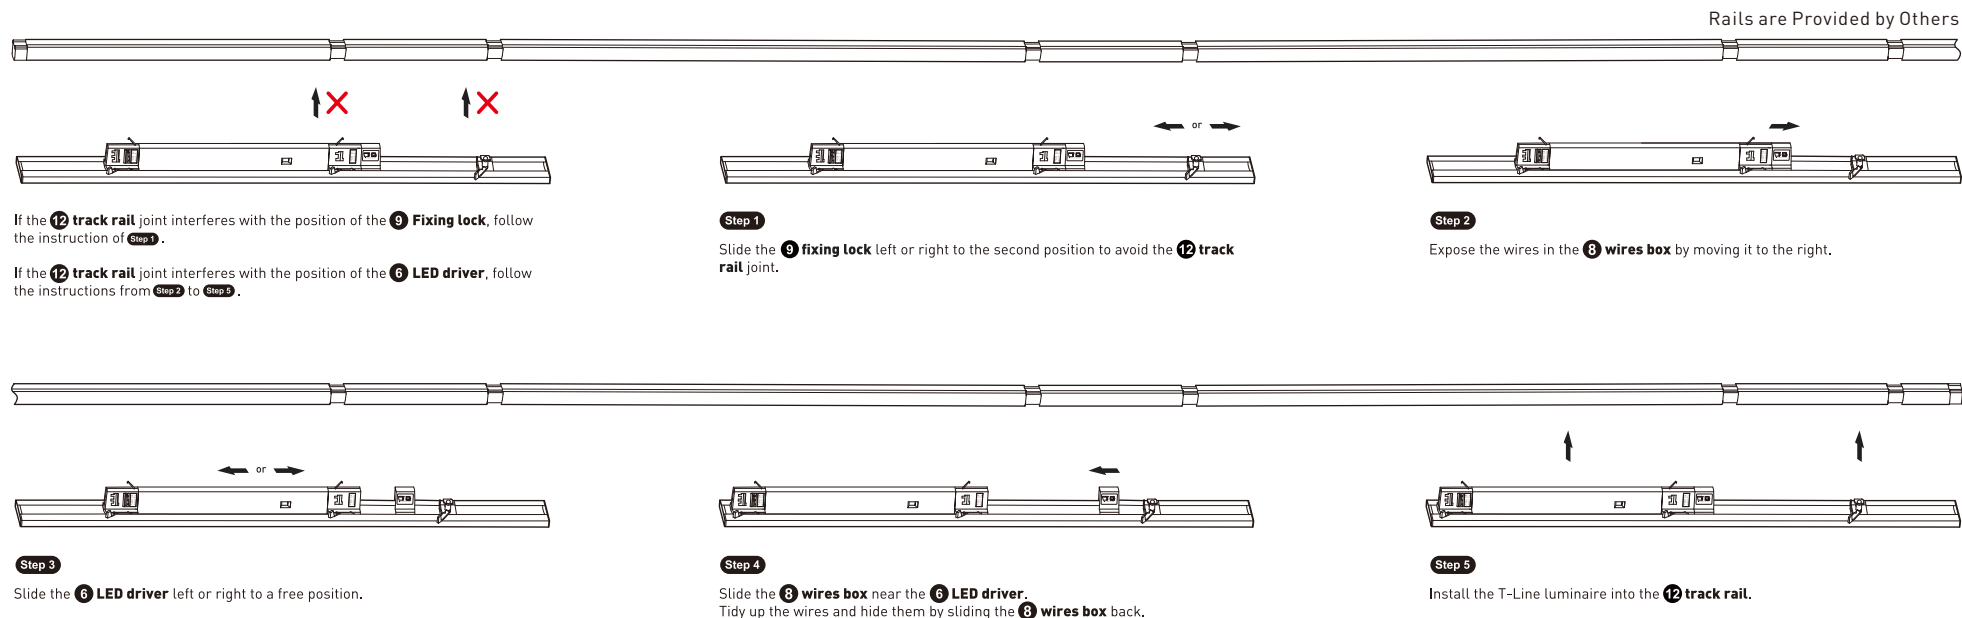

ATTENTION: Install in accordance with national and local building and electrical codes.

All rights reserved. Due to continuous product improvements, specifications and dimensions are subject to change without notice.